

W9 1378171 0211 A04
www.schneider-electric.com

Contents of Toxic or Hazardous Substances or Elements									
有毒有害物质或元素 Toxic or hazardous Substances and Elements									
铅 (Pb)	镉 (Cd)	六价铬 (Cr ⁶⁺)	多溴联苯 (PBB)	多溴二苯醚 (PBDE)					
X	O	O	O	O					
O : 表示该有毒有害物质在该部件所有均质材料中的含量均在 SJ/T11363-2006 标准规定的限量要求以下。 Indicates that this toxic or hazardous substance contained in all of the homogeneous materials for this part is below the limit requirement in SJ/T11363-2006. X : 表示该有毒有害物质至少在该部件的某一均质材料中的含量超出 SJ/T11363-2006 标准规定的限量要求。 Indicates that this toxic or hazardous substance contained in at least one of the homogeneous materials used for this part is above the limit requirement in SJ/T11363-2006. 对销售之目的所有产品, 本表显示: 施耐德电气供应链的电子产品信息可能包含这些物质。 注意: 在所有产品中可能会含有所有列出的部件。 Note: The products on sale may or may not contain all the parts/components listed here.									

⚠ DANGER / 危险


HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH
Disconnect all power before servicing equipment.
Failure to follow these instructions will result in death or serious injury.

可能有触电、爆炸或电弧灼伤危险
在此电力设备上进行操作时, 请先断开所有电源。
不遵循上述规定将可能导致人员伤亡。

⚠ WARNING / 警告

RISK OF FIRE OR ELECTRIC SHOCK (FOR DEVICE WITH UL HI-FAULT SHORT CIRCUIT CURRENT RATINGS ONLY)
The opening of the branch-circuit protective device may be an indication that a fault current has been interrupted.
To reduce the risk of fire or electric shock, current-carrying parts and the other components of the controller should be examined and replaced if damaged.
Failure to follow these instructions can result in death, serious injury, or equipment damage.

可能有火灾或者触电的危险 (仅限UL高故障短路电流额定值的接触器)。
支路保护设备断开, 表明故障电流已被中断。为降低火灾或触电风险, 应检查带电部件和
其他控制元件, 如有损坏, 需及时更换。
不遵循上述规定将可能导致人员伤亡或设备损坏。





Setting the relay / Réglage du relais
Einstellung des Relais / Ajuste del relé
Regolazione dei relais / Regulação do relé
设置继电器


Stop function / Arrêt
Stop Funktion / Función de parada
Stop / Paragem
停止功能

Manual reset / Réarmement manuel
Hand Reset / Rearmamento manual
Ricarica manuale / Rearme manual
手动复位


Test function / Fonction test
Test Funktion / Función test
Test funzioni / Teste função
测试功能

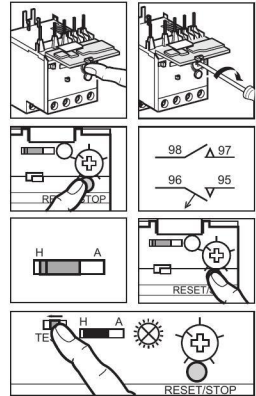


With self-maintaining / Avec auto-maintien
Mit Selbsthaltungsfunktion / Con mantenimiento automático
Con automantenimento / Com auto-manutenção

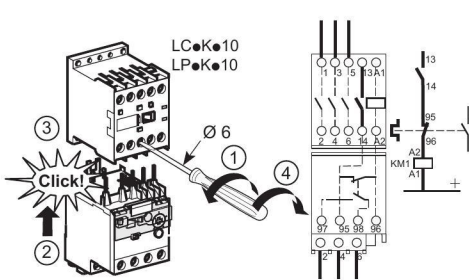

Without self-maintaining / Sans auto-maintien
Ohne Selbsthaltungsfunktion / Sin mantenimiento automático
Senza automantenimento / Sem auto-manutenção

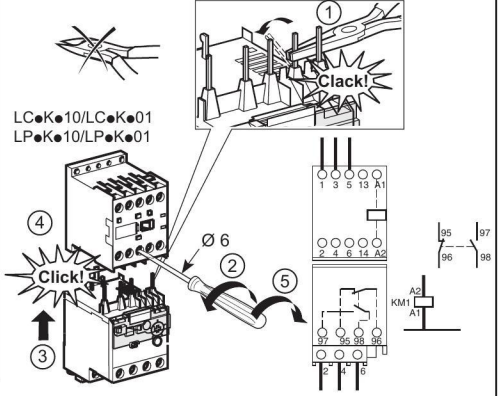

Schneider Electric Industries SAS
35, rue Joseph Monier
92506 Rueil Malmaison
France

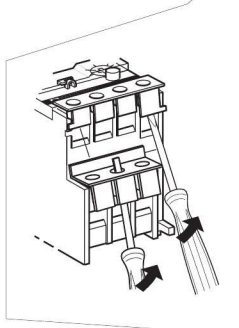

Philips No. 2							Ø 6		
[mm ²]	[mm ²]	[mm ²]	[mm ²]	[mm ²]	[mm ²]	[mm]	C [N.m]	L [mm]	Ø [mm]
0.34	0.34...2.5	0.75	0.75...4	1.5	1.5...4	7	0.8	7	3
: 2.5	: 0.34...1.5	: 4	: 0.75...4	: 4	: 1.5...4				

Torque : 7 lb.in AWG : 1 x 18 min.
2 x 14 or 1 x 12 max.

